


| APP'L | DATE | LVL | REVISION |
|-------|---------|-----|----------|
| | 4-14-93 | B | ECN 5193 |

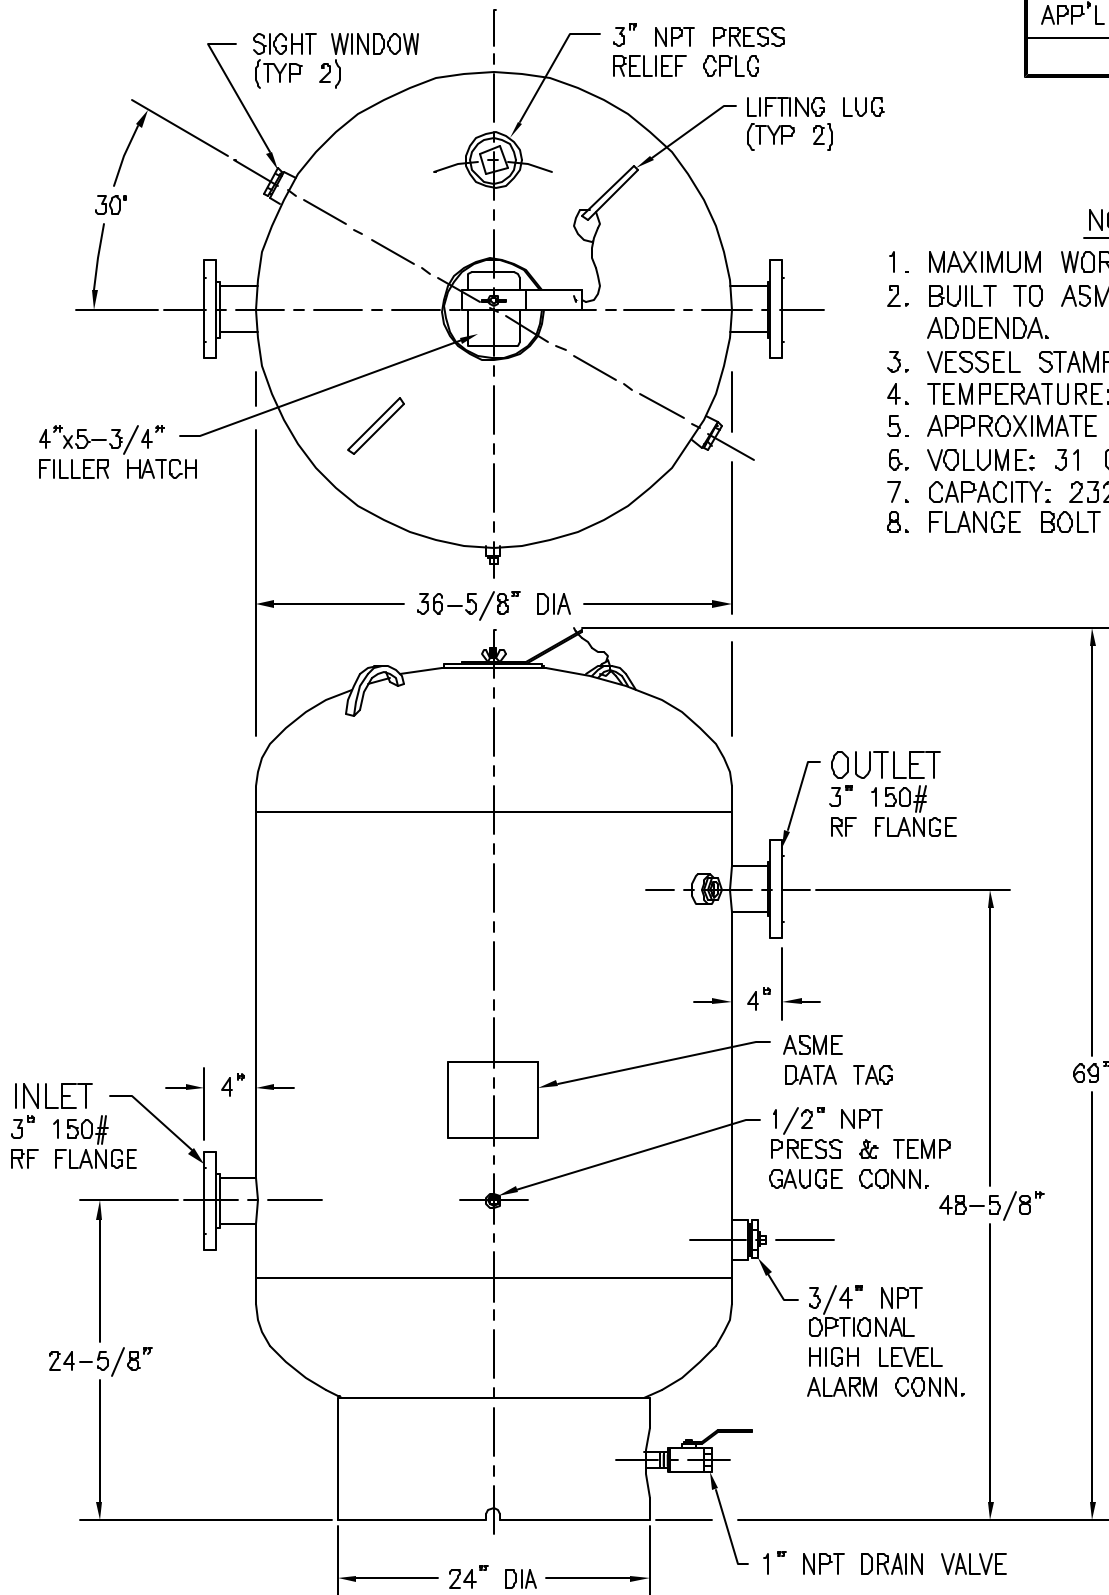

NOTES

1. MAXIMUM WORKING PRESSURE: 150 PSIG.
2. BUILT TO ASME CODE PLUS CURRENT ADDENDA.
3. VESSEL STAMPED "U" SYMBOL.
4. TEMPERATURE: -20°F TO 300°F.
5. APPROXIMATE WEIGHT: 780 LBS.
6. VOLUME: 31 CU.FT.
7. CAPACITY: 232 GALLONS.
8. FLANGE BOLT HOLES STRADDLE C'S.

OPTIONAL EQUIPMENT
 PRESSURE & TEMPERATURE GAUGE KIT
 HIGH LEVEL ALARM KIT
 PRESSURE GAUGE KIT
 TEMPERATURE GAUGE KIT

P/N 80-0010

This drawing is the property of **VAN AIR SYSTEMS INC**

and is subject to return upon request. It shall not be copied or duplicated in any manner and shall not be submitted to outside parties for examination without the consent of Van Air Systems Inc. It shall be used for reference to work under contract or proposals submitted by Van Air Systems Inc. only.

DELIQUESCENT DRYER
D-36

| | | | |
|--------------|---------------|-------------------|-------|
| DRWN BY: MJM | DATE: 4-14-93 | DRWG No. SD-11638 | REV B |
| CHECKED: | SCALE: NONE | | |

APPL: **VAN AIR SYSTEMS INC**
 Lake City, PA 16423 (814)774-2631 Fax: 814/774-3482 Telex: 91-4548